

## Single On/Off D

ORDERING CODE	FREQUENCY
CKNHND1	868,4 MHz

This module is used for switching on or off the electrical device (e.g. light or fan). The module can be controlled either through wireless network or through the wall switch. The module is designed to be mounted inside a “flush mounting box”, hidden behind a traditional wall switch.

Module supports connection of digital temperature sensor. It is designed to act as repeater in order to improve range and stability of wireless network.

### Supported switches

Module supports **mono-stable** switches (push button) and **bi-stable** switches. The module is factory set to operate with bi-stable switches.

### Installation

- To prevent electrical shock and/or equipment damage, disconnect electrical power at the main fuse or circuit breaker before installation or any servicing.
- Make sure, that no voltage is present in the installation.
- Prevent the disconnecting device from being switched on accidentally.
- Connect the module according to electrical diagram.
- Locate the antenna far from metal elements (as far as possible).
- Do not shorten the antenna.

### Danger of electrocution!


- Module installation requires a great degree of skill and may be performed only by a qualified and licensed electrician.
- Even when the module is turned off, voltage may be present on its terminals.

### Note!


Do not connect the module to loads exceeding recommended values. Connect the module only in accordance to the below diagrams. Improper connections may be dangerous.

Electrical installation must be protected by directly associated over current protection fuse 10A, gG or Time lag T, rated breaking capacity 1500V (ESKA 522.727) must be used according to wiring diagram to achieve appropriate overload protection of the module. The fuse must be installed in fuse holder type: Adels contact 503 Si / 1DS.

### Electrical diagram 230VAC



### Option for different load power supply - DPLS:




### Notes for the diagrams:


- N** Neutral lead
- L** Live lead
- Q+** Input for electrical device power supply
- Q-** Output for electrical device
- I2** Input for switch /push button or sensor
- I1** Input for switch /push button
- TS** Terminal for digital temperature sensor (only for On/Off D relay module compatible digital temperature sensor, which must be ordered separately).

Wago 221-413 splicing connectors for L and N connection must be used.

### Electrical diagram 24VDC



### Option for different load power supply - DPLS:

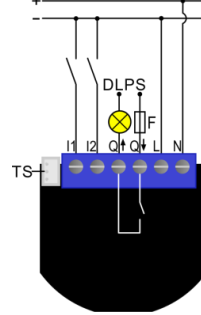


### Notes for the diagrams:

- N** + VDC
- L** - VDC
- Q+** Input for electrical device power supply
- Q-** Output for electrical device
- I2** Input for switch /push button or sensor
- I1** Input for switch /push button
- TS** Terminal for digital temperature sensor (only for On/Off D relay module compatible digital temperature sensor, which must be ordered separately).

### Note!

Output contact is voltage free (dry contact), so also loads with different power supply can be connected to the module.



- S** Service button (used to add or remove module from the Cockpit system in case of 24 V SELV power supply).

WARNING: Service button S **must NOT be used** when module is connected to 110-230V power supply.

Durability of the module depends on applied load. For resistive load (light bulbs, etc.) and 10A current consumption of each individual electrical device, the durability exceeds 100.000 switches of each individual electrical device.

### Module Inclusion (Adding to Z-wave network)

- Connect module to power supply (with temperature sensor connected - if purchased),
- auto-inclusion (works for about 5 seconds after connected to power supply) or
- press push button I1 three times within 3s (3 times change switch state within 3 seconds) or
- press service button **S** (only applicable for 24V SELV supply voltage) for more than 2 second.

NOTE1: For auto-inclusion procedure, first set main controller into inclusion mode and then connect module to power supply.

NOTE2: When connecting temperature sensor to module that has already been included, you have to exclude module first. Switch off power supply, connect the sensor and re-include the module.

### Module Exclusion/Reset (Removing from Z-Wave network)

- Connect module to power supply
- bring module within maximum 1 meter (3 feet) of the main controller,
- enable add/remove mode on main controller
- press push button I1 five times within 3s (5 times change switch state within 3 seconds) in the first 60 seconds after the module is connected to the power supply or
- press service button **S** (only applicable for 24V SELV supply voltage) for more than 6 second.

By this function all parameters of the module are set to default values and own ID is deleted. If push button I1 is pressed three times within 3s (or service button S is pressed more than 2 and less than 6 seconds) module is excluded, but configuration parameters are not set to default values.

NOTE: If the module is included with parameter 100 with values different to default and module reset is done, wait at least 30s before next inclusion.

### Associations

Associations enables On/Off D Module module to transfer commands inside Z-Wave network directly (without main controller) to other Z-Wave modules.

### Associated Groups:

#### Root device:

Group 1: Lifeline group (reserved for communication with the main controller), 1 node allowed.

Group 2: basic on/off (triggered at change of the output state and reflecting its state) up to 16 nodes.

Group 3: basic on/off (triggered at change of the input I2 state and reflecting its state) up to 16 nodes.

Group 4: Binary Sensor Report (triggered at change of the input I2 state and reflecting its state) up to 16 nodes.

Group 5: Notification Report (triggered at change of the input I2 state and reflecting its state) up to 16 nodes.

Group 6: multilevel sensor report (triggered at change of temperature sensor) up to 16 nodes.

#### Endpoint 1:

Group 1: Lifeline group, 0 nodes allowed.

Group 2: basic on/off (triggered at change of the output state and reflecting its state) up to 16 nodes.

#### Endpoint 2:

Group 1: Lifeline group, 0 nodes allowed.

Group 2: basic on/off (triggered at change of the input I2 state and reflecting its state) up to 16 nodes.

Group 3: Binary Sensor Report (triggered at change of the input I2 state and reflecting its state) up to 16 nodes.

Group 4: Notification Report (triggered at change of the input I2 state and reflecting its state) up to 16 nodes.

#### End point 3:

Group 1: Lifeline group, 0 nodes allowed.

Group 2: multilevel sensor report (triggered at change of temperature sensor) up to 16 nodes.

### Configuration parameters

#### Parameter no. 1 – Input 1 switch type

Available configuration parameters (data type is 1 Byte DEC):

- default value 1
- 0 - mono-stable switch type (push button)
- 1 - bi-stable switch type

#### Parameter no. 2 – Input 2 contact type

Available configuration parameters (data type is 1 Byte DEC):

- default value 0
- 0 - NO (normally open) input type
- 1 - NC (normally close) input type

#### Parameter no. 10 - Activate / deactivate functions ALL ON/ALL OFF

Available configuration parameters (data type is 2 Byte DEC):

- default value 255
- 255 - ALL ON active, ALL OFF active
- 0 - ALL ON is not active ALL OFF is not active
- 1 - ALL ON is not active ALL OFF active
- 2 - ALL ON active ALL OFF is not active

On/Off D Module module responds to commands ALL ON / ALL OFF that may be sent by the main controller or by other controller belonging to the system.

#### Parameter no. 11 - Automatic turning off output after set time

When relay is ON it goes automatically OFF after time defined by this parameter. Timer is reset to zero each time the module receive ON command regardless from where it comes (push button, associated module, controller,...).

Available configuration parameters (data type is 2 Byte DEC):

- default value 0
- 0 - Auto OFF disabled
- 1 - 32535 = 1second (0,01s) – 32535 seconds (325,35s) Auto OFF enabled with define time, step is 1s or 10ms according to parameter nr.15

### Parameter no. 12 - Automatic turning on output after set time

When relay is OFF it goes automatically ON after time defined by this parameter. Timer is reset to zero each time the module receive OFF command regardless from where it comes (push button, associated module, controller...). Available configuration parameters (data type is 2 Byte DEC):

- default value 0
- 0 - Auto ON disabled
- 1 - 32535 = 1second (0,01s) - 32536 seconds (325,35s) Auto ON enabled with define time, step is 1s or 10ms according to parameter nr.15

### Parameter no. 15 - Automatic turning off / on seconds or milliseconds selection

Available configuration parameters (data type is 1 Byte DEC):

- default value 0
- 0 - seconds selected
- 1 - milliseconds selected

NOTE: This parameter is valid for both, turning on and turning off parameters.

### Parameter no. 30 - Saving the state of the relay after a power failure

Available configuration parameters (data type is 1 Byte DEC):

- default value 0
- 0 - On/Off D Module module saves its state before power failure (it returns to the last position saved before a power failure)
- 1 - On/Off D Module module does not save the state after a power failure, it returns to "off" position.

### Parameter no. 63 – Output Switch selection

Set value means the type of the device that is connected to the output. The device type can be normally open (NO) or normally close (NC).

Available configuration parameters (data type is 1 Byte DEC):

- default value 0
- 0 - When system is turned off the output is 0V (NC).
- 1 - When system is turned off the output is 230V or 24V (NO).

### Parameter no. 100 – Disable Endpoint I2 or select Notification Type and Event

Enabling I2 means that Endpoint (I2) will be present on UI. Disabling it will result in hiding the endpoint according to the parameter set value. Additionally, a Notification Type and Event can be selected for the endpoint. Available configuration parameters (data type is 1 Byte DEC):

### Endpoint device type selection:

#### - notification sensor (1 - 6):

GENERIC\_TYPE\_SENSOR\_NOTIFICATION,  
SPECIFIC\_TYPE\_NOTIFICATION\_SENSOR

- default value 0
- 1 - Home Security; Motion Detection, unknown location
- 2 - Carbon Monoxide; Carbon Monoxide detected, unknown location.
- 3 - Carbon Dioxide; Carbon Dioxide detected, unknown location.
- 4 - Water Alarm; Water Leak detected, unknown location.
- 5 - Heat Alarm; Overheat detected, unknown location.
- 6 - Smoke Alarm; Smoke detected, unknown location.
- 0 - Endpoint, I2 disabled

#### - sensor binary (9):

GENERIC\_TYPE\_SENSOR\_BINARY,  
SPECIFIC\_TYPE\_NOT\_USED

- 9 - Sensor binary

NOTE 1: After parameter change, first exclude module (without setting parameters to default value) then wait at least 30s and then re include the module!

NOTE 2: When the parameter is set to value 9 the notifications are send for Home Security.

### Parameter no. 110 – Temperature sensor offset settings

Set value is added or subtracted to actual measured value by sensor. Available config. parameters (data type is 2 Byte DEC):

- default value 32536
- 32536 - offset is 0.0C
- From 1 to 100 - value from 0.1 °C to 10.0 °C is added to actual measured temperature.
- From 1001 to 1100 - value from -0.1 °C to -10.0 °C is subtracted to actual measured temperature.

### Parameter no. 120 – Temperature sensor reporting

If digital temperature sensor is connected, module reports measured temperature on temperature change defined by this parameter.

Available configuration parameters (data type is 1 Byte DEC):

- default value 5 = 0,5°C
- 0 - Reporting disabled
- 1- 127 = 0,1°C - 12,7°C, step is 0,1°C

### Technical Specifications

Power supply	110 - 230 VAC ±10% 50/60Hz, (24-30VDC)
Rated load current of AC	1 X 10A / 230VAC

output (resistive load)*	
Rated load current of DC output (resistive load)	1 X 10A / 30VDC
Output circuit power of AC output (resistive load)	2300W (230VAC)
Output circuit power of DC output (resistive load)	240W (24VDC)
Digital temperature sensor range (sensor must be ordered separately)	-50 ~ +125°C
Operation temperature	-10 ~ +40°C
Distance	up to 30 m indoors (depending on building materials)
Dimensions (WxHxD) (package)	41,8x36,8x15,4mm (79x52x22mm)
Weight (Brutto with package)	28g (34g)
Electricity consumption	0,4W
For installation in boxes	Ø ≥ 60mm or 2M, depth ≥ 60mm
Switching	Relay

\* In case of load other than resistive, pay attention to the value of  $\cos \varphi$  and if necessary apply load lower than the rated load. Max current for  $\cos \varphi=0,4$  is 3A at 250VAC, 3A at 24VDC L/R=7ms.

#### Supported loads:

- Ⓜ Electric motor
- ⚡ Convent. incandescent and halogen lights
- ⚡ LED and CFL bulb, low voltage halogen bulbs with electronic transformer
- ⚡ Low voltage halogen bulbs with conventional transformer

#### Z-Wave Device Class:

ZWAVEPLUS\_INFO\_REPORT\_ROLE\_TYPE\_SLAVE\_AL  
WAYS\_ON  
GENERIC\_TYPE\_SWITCH\_BINARY  
SPECIFIC\_TYPE\_POWER\_SWITCH\_BINARY

#### Z-Wave Supported Command Classes:

COMMAND\_CLASS\_ZWAVEPLUS\_INFO  
COMMAND\_CLASS\_VERSION\_V2  
COMMAND\_CLASS\_MANUFACTURER\_SPECIFIC  
COMMAND\_CLASS\_DEVICE\_RESET\_LOCALLY  
COMMAND\_CLASS\_POWERLEVEL  
COMMAND\_CLASS\_BASIC  
COMMAND\_CLASS\_SENSOR\_BINARY  
COMMAND\_CLASS\_NOTIFICATION\_V5  
COMMAND\_CLASS\_SWITCH\_ALL  
COMMAND\_CLASS\_SWITCH\_BINARY

COMMAND\_CLASS\_SENSOR\_MULTILEVEL\_V7  
COMMAND\_CLASS\_MULTI\_CHANNEL\_V4  
COMMAND\_CLASS\_ASSOCIATION\_V2  
COMMAND\_CLASS\_MULTI\_CHANNEL\_ASSOCIATION\_V3  
COMMAND\_CLASS\_ASSOCIATION\_GRP\_INFO\_V2  
COMMAND\_CLASS\_CONFIGURATION  
COMMAND\_CLASS\_MARK  
COMMAND\_CLASS\_BASIC

#### Endpoint 1

COMMAND\_CLASS\_ZWAVEPLUS\_INFO  
COMMAND\_CLASS\_VERSION\_V2  
COMMAND\_CLASS\_BASIC  
COMMAND\_CLASS\_SWITCH\_ALL  
COMMAND\_CLASS\_SWITCH\_BINARY  
COMMAND\_CLASS\_ASSOCIATION\_V2  
COMMAND\_CLASS\_MULTI\_CHANNEL\_ASSOCIATION\_V3

COMMAND\_CLASS\_ASSOCIATION\_GRP\_INFO\_V2  
COMMAND\_CLASS\_MARK  
COMMAND\_CLASS\_BASIC

#### Endpoint 2 (I2):

##### Device Class:

ZWAVEPLUS\_INFO\_REPORT\_ROLE\_TYPE\_SLAVE\_AL  
WAYS\_ON  
GENERIC\_TYPE\_SENSOR\_NOTIFICATION  
SPECIFIC\_TYPE\_NOTIFICATION\_SENSOR

##### Command Classes:

COMMAND\_CLASS\_ZWAVEPLUS\_INFO  
COMMAND\_CLASS\_VERSION\_V2  
COMMAND\_CLASS\_SENSOR\_BINARY  
COMMAND\_CLASS\_BASIC  
COMMAND\_CLASS\_NOTIFICATION\_V5  
COMMAND\_CLASS\_ASSOCIATION\_V2  
COMMAND\_CLASS\_MULTI\_CHANNEL\_ASSOCIATION\_V3  
COMMAND\_CLASS\_ASSOCIATION\_GRP\_INFO\_V2  
COMMAND\_CLASS\_MARK  
COMMAND\_CLASS\_BASIC

#### Endpoint 3:

##### Device Class:

ZWAVEPLUS\_INFO\_REPORT\_ROLE\_TYPE\_SLAVE\_AL  
WAYS\_ON  
GENERIC\_TYPE\_SENSOR\_MULTILEVEL  
SPECIFIC\_TYPE\_ROUTING\_SENSOR\_MULTILEVEL

##### Command Classes:

COMMAND\_CLASS\_ZWAVEPLUS\_INFO\_V2  
COMMAND\_CLASS\_VERSION\_V2  
COMMAND\_CLASS\_ASSOCIATION\_V2  
COMMAND\_CLASS\_MULTI\_CHANNEL\_ASSOCIATION\_V3  
COMMAND\_CLASS\_ASSOCIATION\_GRP\_INFO\_V2  
COMMAND\_CLASS\_SENSOR\_MULTILEVEL\_V7

NOTE: The above list is valid for the product with

a temperature sensor connected to TS terminal. In case the sensor isn't connected then following command class isn't supported:

COMMAND\_CLASS\_SENSOR\_MULTILEVEL\_V7  
This product can be included and operated in any Z-Wave network with other Z-Wave certified devices from any other manufacturers. All constantly powered nodes in the same network will act as repeaters regardless of the vendor in order to increase reliability of the network.

#### Important disclaimer

Z-Wave wireless communication is inherently not always 100% reliable, and as such, this product should not be used in situations in which life and/or valuables are solely dependent on its function.

#### Warning!

Do not dispose of electrical appliances as unsorted municipal waste, use separate collection facilities. Contact your local government for information regarding the collection systems available. If electrical appliances are disposed of in landfills or dumps, hazardous substances can leak into the groundwater and get into the food chain, damaging your health and well-being. When replacing old appliances with new once, the retailer is legally obligated to take back your old appliance for disposal at least for free of charge. Products are not authorized for use as critical devices in life support systems or applications. Life support systems or applications are systems or applications which support or sustain life, and whose failure to perform, when properly used in accordance with instructions for use provided in the labelling, can be reasonably expected to result in a significant injury to the user.

This user manual is subject to change and improvement without notice. NOTE: User manual is valid for module with SW version S5 (SW version is part of P/N)!



Cockpit Smart Home d.o.o.  
Ulica Klementa Juga 007  
5250 Solkan, Slovenia  
Web: www.yourcockpit.biz  
Tel: +386 5 335 95 00

Date: 04.03.2018

Document: Cockpit SL\_Single On Off D user manual\_V1.5B\_eng